

SEPTIC REPORT



KFL&A
Public Health

APPLICATION # BE-19-16	Entered P
----------------------------------	---------------------


KINGSTON, FRONTENAC AND LENNOX & ADDINGTON PUBLIC HEALTH FINAL INSPECTION REPORT FOR CLASS 2, 3, 4, 5 SEWAGE SYSTEM

Inspection Details

OWNER [Redacted] INSTALLER **Kevin Mulrooney Trucking**
(10946al.) **Kevin Mulrooney**

- Work has been satisfactorily completed and includes:
 - Septic tank / holding tank / treatment unit of working capacity of **4141** litres constructed of concrete plastic serving **3**
Make / Model of Tank: **1060 Infiltrator**
(4000 gal @ 20') **24.3** metres of **3" 75** mm diameter distribution pipe of **Royal** (type and product description) laid in **4** runs and fed by **Gravity** If Filter Bed: Loading Area **12' x 23'** **25.6** m² Contact Area m² Level _____
 - Treatment Unit Make / Model: _____
 - Chamber System Make / Model: _____
 - Leaching Bed GPS Coordinates: Latitude N **44°40'00.8"** Longitude W **076°37'31.6"** # of Pieces: _____

2. Location: The sketch below indicates the location of all components of the Sewage System and separation distances as required under the Ontario Building Code.

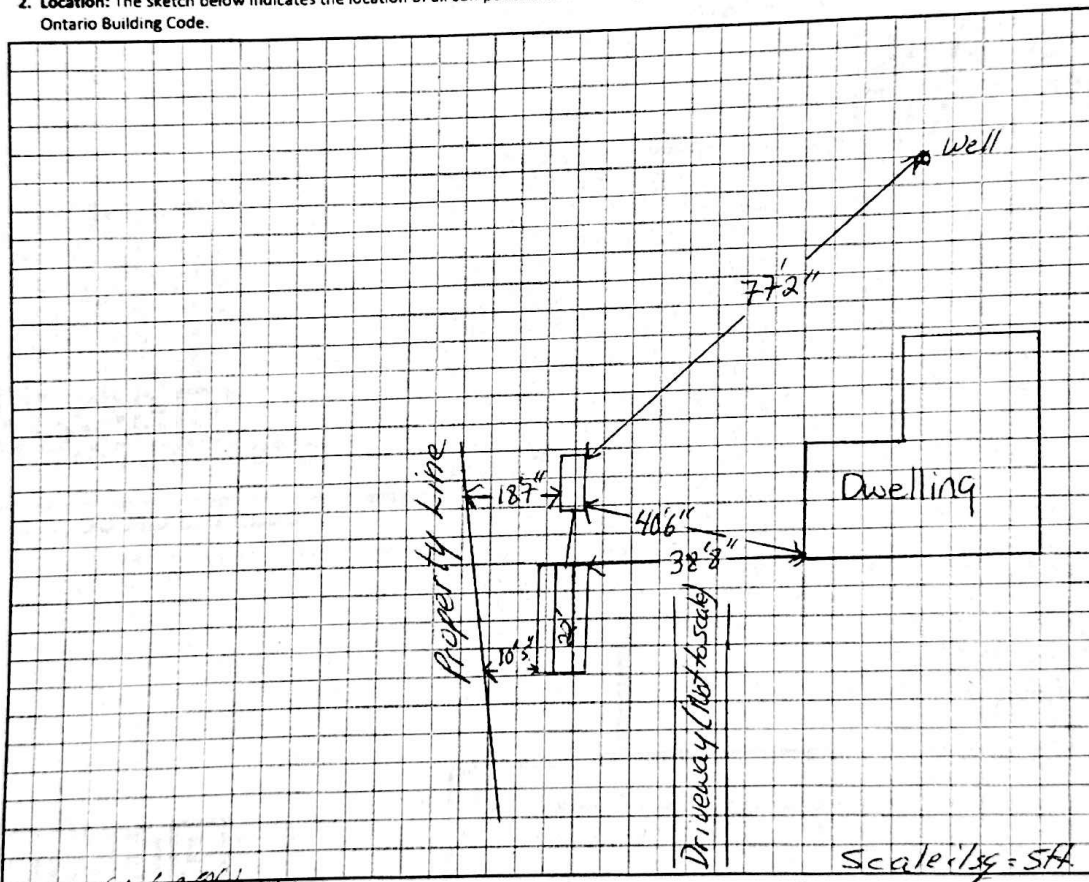

Inspector *[Signature]* Inspection Date **Nov. 6, 2017**

The Sewage System was inspected and it has been determined that the installation complies with the requirements of Regulation 332/12 made under the Building Code Act for the following property located on Lot **24** Concession **3** Municipality **S Frontenac**
District **Bedford** Municipal address **289 Maple Grove Lane**
Registered Plan # _____ Part(s) _____ Plan of Subdivision # _____ Sublot _____

- Final Compliance Inspection - the following work ~~has been~~ ^{to be} completed: **SM**
- System has been backfilled with suitable granular fill
 - Grading to shed run-off and divert water around leaching bed has been completed
 - Sloped surfaces are stabilized
 - Topsoil has been put on the leaching bed to establish grass cover
 - Other _____

Inspector *[Signature]* Date **June 3/19**

KFL&A Public Health (FEB16)



Perth & District Septic Service Ltd. and Portable
777 Otty Lake Side Road
ON K7H 0E8
+16132673350
info@perthseptic.com
Business Number 104154950

Receipt

Received From

Date: 08/01/2025

████████████████████
289 MAPLE GROVE LANE
TICHBORNE ON

Reference No: CAVSbQsb

Invoice Number	Invoice Date	Due Date	Original Amount	Balance	Payment
29393	07/22/2025	08/06/2025	536.75	536.75	536.75

Memo: PAID BY E-TRANSFER
REF CAVSbQsb

Amount Credited: \$0.00
Total: \$536.75