

OUT OF RANGE PLOTTED NEAR BY

The Ontario Water Resources Act

3109W

WATER WELL RECORD

1. PRINT ONLY IN SPACES PROVIDED
2. CHECK CORRECT BOX WHERE APPLICABLE

11 2209668 22010 C9N 114

COUNTY OR DISTRICT: **Frontenac** TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE: **Leachborough** CON. BLOCK TRACT, SURVEY, ETC: **14** DATE COMPLETED: **23** MO **08** YR **83**

ADDRESS: **R#1 Perth Road Ont. K0R2L0**

HIGH: **932.499** RC: **5** ELEVATION: **050.0** RC: **5** BASIN CODE: **25**

LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
Brown Sand				0'	1 1/2'
Grey Granite				1 1/2'	115'



31 0002628 0115221

41 WATER RECORD

WATER FOUND AT - FEET	KIND OF WATER			
10-13	<input checked="" type="checkbox"/> FRESH	<input type="checkbox"/> SALTY	<input type="checkbox"/> SULPHUR	<input type="checkbox"/> MINERAL
15-18	<input checked="" type="checkbox"/> FRESH	<input type="checkbox"/> SALTY	<input type="checkbox"/> SULPHUR	<input type="checkbox"/> MINERAL
20-23	<input type="checkbox"/> FRESH	<input type="checkbox"/> SALTY	<input type="checkbox"/> SULPHUR	<input type="checkbox"/> MINERAL
25-28	<input type="checkbox"/> FRESH	<input type="checkbox"/> SALTY	<input type="checkbox"/> SULPHUR	<input type="checkbox"/> MINERAL
30-33	<input type="checkbox"/> FRESH	<input type="checkbox"/> SALTY	<input type="checkbox"/> SULPHUR	<input type="checkbox"/> MINERAL

51 CASING & OPEN HOLE RECORD

INSIDE DIAM INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
6 1/4	<input checked="" type="checkbox"/> STEEL	3/16	0'	102'
	<input type="checkbox"/> GALVANIZED			
	<input type="checkbox"/> CONCRETE			
	<input type="checkbox"/> OPEN HOLE			

61 PLUGGING & SEALING RECORD

DEPTH SET AT - FEET	MATERIAL AND TYPE	DEPTH TO TOP OF SCREEN
10-13		14-17
18-21		22-25
26-29		30-33

71 PUMPING TEST

PUMPING TEST METHOD: PUMP BAILER

PUMPING RATE: **0003** GPM


DURATION OF PUMPING: **02** HOURS **00** MINS

STATIC LEVEL	WATER LEVEL END OF PUMPING	WATER LEVELS DURING			
028'	105'	15 MINUTES	30 MINUTES	45 MINUTES	60 MINUTES
		057'	84'	87'	105'

RECOMMENDED PUMP TYPE: SHALLOW DEEP

RECOMMENDED PUMP SETTING: **110** FEET

RECOMMENDED PUMPING RATE: **0003** GPM

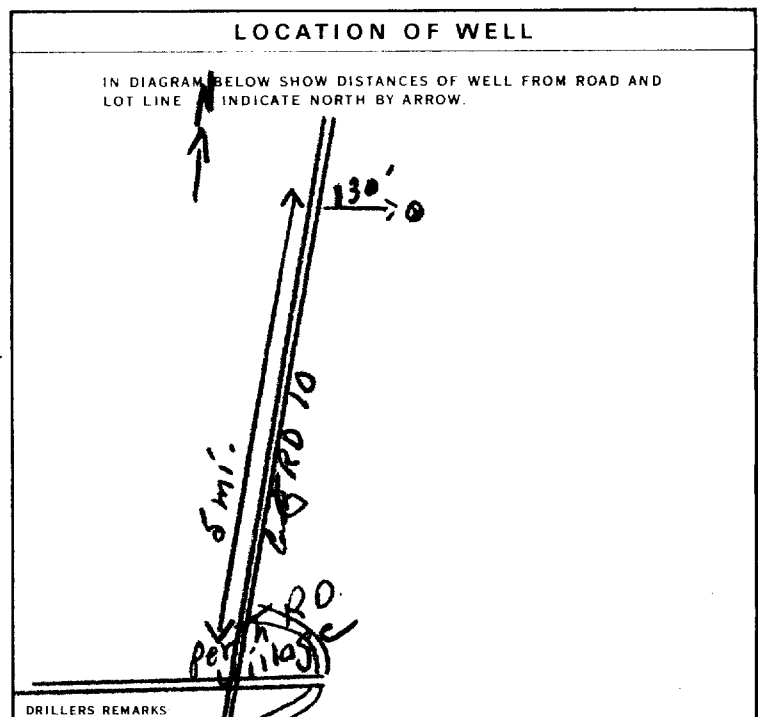

FINAL STATUS OF WELL

1 WATER SUPPLY

WATER USE

1 DOMESTIC

METHOD OF DRILLING

5 AIR PERCUSSION

CONTRACTOR: **JACK KNOX** LICENCE NUMBER: **3202**

ADDRESS: **Glenburnie**

NAME OF DRILLER OR BORER: **Ron Knox** LICENCE NUMBER: **3219**

SIGNATURE OF CONTRACTOR: **Jack Knox**

SUBMISSION DATE: DAY _____ MO _____ YR _____

OFFICE USE ONLY

DATA SOURCE: **1** CONTRACTOR: **3202** RECEIVED: **25 01 84**

DATE OF INSPECTION: _____ INSPECTOR: _____

REMARKS: _____